


This document and its contents are the property of the Purchaser and are not to be copied, reproduced or disseminated in any way, in part or whole, without prior written approval of the Purchaser. The Purchaser shall be responsible for ensuring that this drawing is not used for any other project. This drawing shall be read in conjunction with the CWC Mechanical and Electrical Specifications. DO NOT SCALE FROM THIS DRAWING.

DESIGNERS RISK ASSESSMENT
REFER TO APPENDIX 1 OF M&E SPECIFICATION FOR DESIGNERS RISK ASSESSMENT SCHEDULE

DRAWING BACKGROUND:
ROOF LEVEL PV ARRAY AND INVERTOR



- PV NOTES:**
1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN, SUPPLY, INSTALLATION & COMMISSIONING FOR THE COMPLETE SERVICES INSTALLATION.
 2. THE PROPOSED SYSTEM CONSISTS OF 2400x550W PANELS AND CAPACITY OF 1320kWp. THE OVERALL AREA OF PV TO ACHIEVE THE PEAK GENERATING LOAD IS 720m².
 3. THE CONTRACTOR SHALL ENSURE THE PV PANELS COMPLY WITH THE SOLAR PANEL PROCUREMENT AND LABOUR RISK MITIGATION GUIDANCE.
 4. ALL ROOF MOUNTED CABLE TRAY SHALL BE GALVANISED WITH GALVANISED COVERS AND SUITABLY SALINE TREATED.
 5. ALL PHOTOVOLTAIC PANELS SHALL BE WIRED & INTERCONNECTED USING JMCABLES H1222-4 CABLE OR EQUIVALENT TO COMPLY WITH BS EN 50618 OR EQUAL AND APPROVED.
 6. A SPECIALIST CONTRACTOR SHALL BE EMPLOYED FOR THE DESIGN, SUPPLY, INSTALLATION AND COMMISSION OF THE NEW PHOTOVOLTAIC SYSTEM.
 7. A SPECIALIST CONTRACTOR SHALL BE EMPLOYED FOR THE DESIGN, SUPPLY, INSTALLATION AND COMMISSION OF THE NEW PHOTOVOLTAIC SYSTEM.
 8. SPECIALIST ROOF SUPPORT BRACKETS TO BE PROVIDED FOR PV ARRAYS.
 9. PV PANELS ON THE FLAT ROOF SMALL PITCH TO BE INSTALLED USING A PROPRIETARY RAIL MOUNTING SYSTEM.
 10. PV STRING GENERATOR JUNCTION BOX SHALL CONTAIN BLOCKING DIODES AND SURGE PROTECTION DEVICE.
 11. A DATA CONNECTION UNIT SHALL BE PROVIDED TO LINK TO THE EXISTING ON SITE M&E SYSTEM.
 12. ALL NEW PHOTOVOLTAIC FRAME SUPPORT SHALL BE INSTALLED USING A PROPRIETARY RAIL MOUNTING SYSTEM.
 13. ALL SOLAR PANELS SHALL BE 550W OR EQUAL AND APPROVED SOLAR MONOCRYSTALLINE SOLAR PANELS. THE TECHNICAL SPECIFICATION SHALL BE AS FOLLOWS:
- PEAK POWER: 550W
- MAX POWER VOLTAGE: 41.7V
- MAX POWER CURRENT: 13.2A
- OPEN CIRCUIT VOLTAGE: 49.8V
- SHORT CIRCUIT CURRENT: 14A
- POWER TOLERANCE: 0+10W
- DIMENSIONS: 2281x1343x35mm
- WEIGHT: 27.8kg
 14. THE APPOINTED PV SPECIALIST SHALL MAKE ALL NECESSARY G99 METER APPLICATIONS AND LIAISE WITH THE STATUTORY BODY IN RELATION TO ANY UPSTREAM NETWORK REINFORCEMENTS THAT MAY BE REQUIRED ON THE SPEN NETWORK IN RELATION TO THE PEAK GENERATING LOAD.
 15. FINAL ORIENTATION OF PV PANELS TO BE AGREED AND FINAL ROOF ACCESS TO BE AGREED. THIS MAY AFFECT SOME PANEL LOCATIONS AND

- GENERAL NOTES:**
1. ALL INFORMATION CONTAINED ON THIS DRAWING IS INDICATIVE FOR INFORMATION PURPOSES ONLY.
 2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEERING SERVICES DRAWINGS, SPECIFICATIONS, SCHEDULES AND PROJECT SPECIFIC DOCUMENTATION.
 3. THE CONTRACTOR SHALL ENSURE FULL COORDINATION WITH ALL OTHER MEP SERVICES, BUILDING CONSTRUCTION AND FABRIC PRIOR TO INSTALLATION.
 4. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CONFIRM FINAL ROUTES AND SIZES. CHECK ALL SITE DIMENSIONS AND ENSURE THAT SERVICES ARE FULLY COORDINATED WITH REGARD TO ACCESS FOR INSTALLATION, COMMISSIONING, MAINTENANCE AND REMOVAL/REPLACEMENT.
 5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR STAGE 4 ONWARD THE FULL DETAILED DESIGN.
 6. INFORMATION QUANTITIES AND LOCATIONS ARE INDICATIVE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DETAILED SERVICES DESIGN INCLUDING FINAL SETTING OUT AND COORDINATION.
 7. ALL PLANT AND EQUIPMENT SHALL BE SUITABLE FOR THE ENVIRONMENTAL LOCATION.
 8. ALL PLANT AND EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS AND INSTRUCTIONS.

P1	09.06.23	PRELIMINARY ISSUE	SB	LS
Rev	Date	Description	Eng	CHK

Alberton House, 30 St Mary's Parsonage
Tel: 0181 634 9999

CWC
crooks walkor
woking

The Plaza, Old Hall Street,
Liverpool L3 9JZ
Tel: 0151 600 5400

55 Colmore Row, Birmingham B3 2AA
Tel: 0121 262 4046
E-mail: admin@conwycouncil.gov.uk
Website: www.conwycouncil.gov.uk


CONWY
CYNGOR BWRDEISTREF SIRIOL
COUNTY BOROUGH COUNCIL

Project
**WASTE TRANSFER CENTER
LLANDUDNO**


Drawing Title
**ROOF LEVEL PV ARRAY
AND INVERTOR LAYOUT**

Status: **PRELIMINARY**


Project No.	2821	Drawn	BW	Scale / Paper Size	1:100 @ A0
Drawing No.	2821-CWC-XX-EX-DR-E-6001	Rev			P1

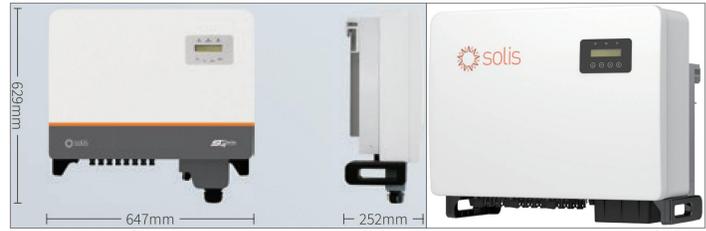


A TYPICAL PV INVERTOR DETAILS FOR UNITS FROM 25KW TO 60KW BY SOLIS

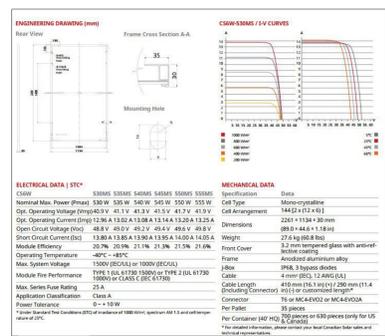

B DETAIL OF THE PROPOSED PV MONOCRYSTALLINE PV PANEL - 550W BY CANADIAN SOLAR

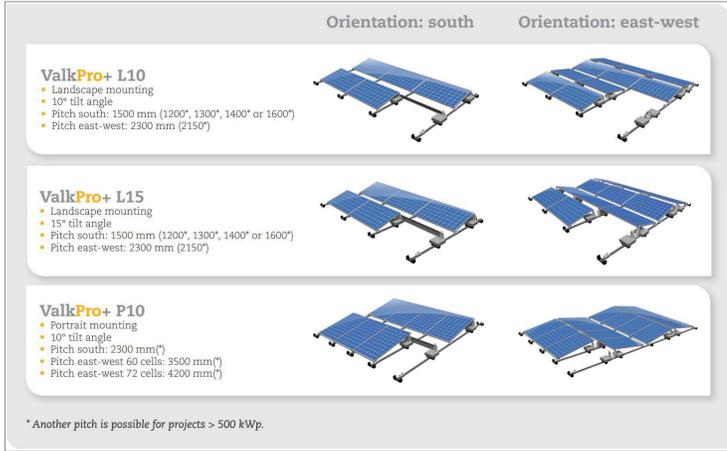

C TYPICAL FLAT ROOF FIXING DETAIL FOR PROPOSED PV ARRAY

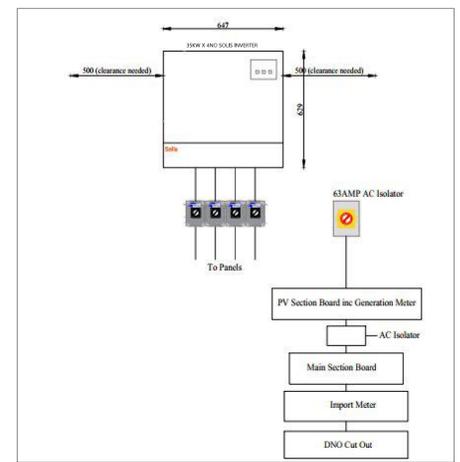

D DETAIL OF INVERTORS AND WIRING BACK INTO LOCAL DISTRIBUTION